


flood vents

- 1 square inch/1 square foot of floor plan area
- 3" round minimum opening
- minimum of 2 openings
- evenly dispersed around perimeter
- bottom of opening shall be 12" or less above the adjacent ground level

Finish Floor Elevation  
(certified by a MD RDP)

Design Flood Elevation  
(Obtain from Zoning)

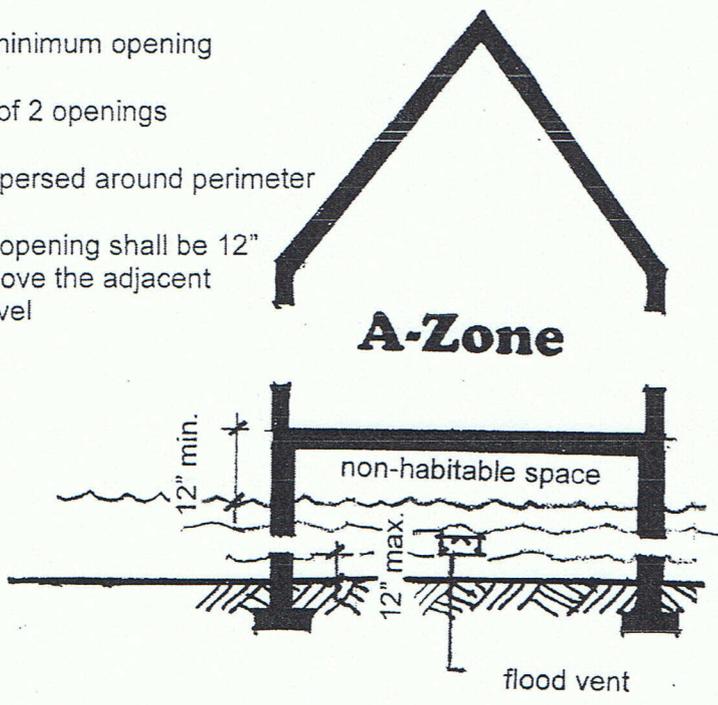


- ⊕ Finish Floor Elevation
- ⊕ Design Flood Elevation
- ⊕ Finish Grade  
finish floor, bottom of crawl space must match or be higher than adjacent grade

bldg plans certified by a MD RDP  
(registered design professional)

column or pile foundation required

Design Flood Elevation  
(Obtain from Zoning)

Finish Floor Elevation  
(certified by a MD RDP)

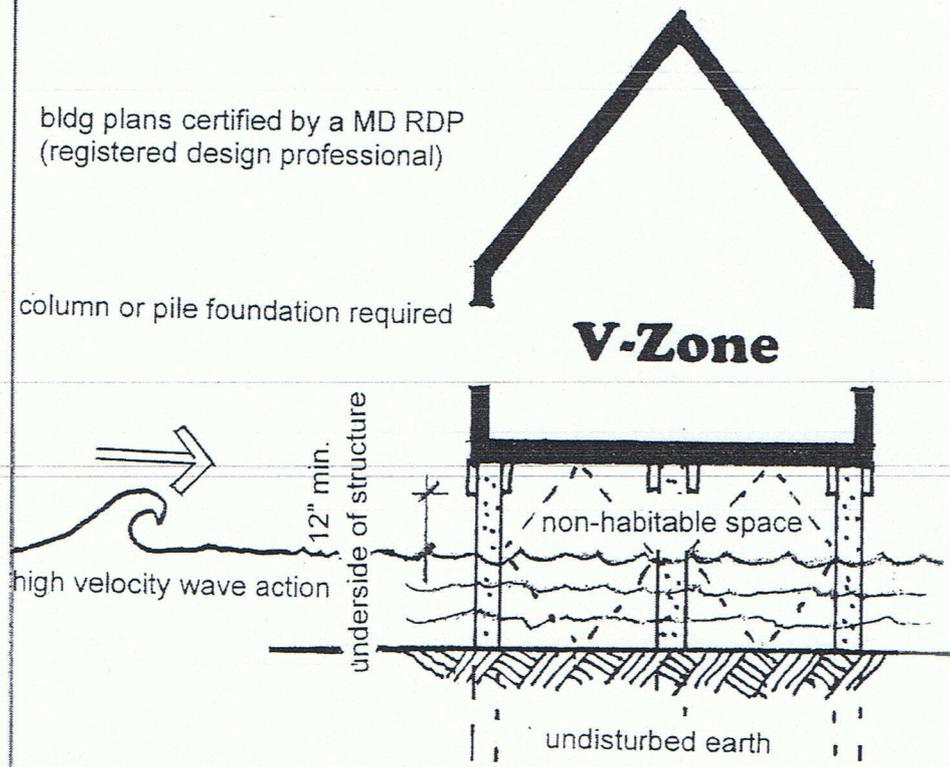

- ⊕ Finish Floor Elevation
- ⊕ break away wall, lattice or screening
- ⊕ Design Flood Elevation
- ⊕ Finish Grade

**Flood Zone Design Requirements**